



Monitoring relays - ENYA series

Monitoring of phase sequence and phase failure

Monitoring of asymmetry

Connection of neutral wire optional

Supply voltage = measuring voltage

1 change over contact

Width 17.5mm

Installation design



## Technical data

### 1. Functions

Monitoring of phase sequence, phase failure and asymmetry with adjustable asymmetry, connection of neutral wire optional.

### 2. Time ranges

Tripping delay: Adjustment range fixed, approx. 100ms

### 3. Indicators

Green LED ON: indication of supply voltage  
Yellow LED ON/OFF: indication of relay output

### 4. Mechanical design

Self-extinguishing plastic housing, IP rating IP40  
Mounted on DIN-rail TS 35 according to EN 60715  
Mounting position: any  
Shockproof terminal connection according to VBG 4 (PZ1 required), IP rating IP20  
Tightening torque: max. 1Nm  
Terminal capacity:  
1 x 0.5 to 2.5mm<sup>2</sup> with/without multicore cable end  
1 x 4mm<sup>2</sup> without multicore cable end  
2 x 0.5 to 1.5mm<sup>2</sup> with/without multicore cable end  
2 x 2.5mm<sup>2</sup> flexible without multicore cable end

### 5. Input circuit

Supply voltage: (= measured voltage)  
Terminals: (N)-L1-L2-L3  
Rated voltage UN: see table ordering information or printing on the unit  
Tolerance: -30% to +30% of U<sub>N</sub>  
Rated consumption: 8VA (0.8W)  
Rated frequency: AC 48 to 63Hz  
Duty cycle: 100%  
Reset time: 500ms  
Hold-up time: -  
Drop out voltage: >20% of the supply voltage  
Overvoltage category: III (in accordance with IEC 60664-1)  
Rated surge voltage: 4kV

### 6. Output circuit

1 potential free change over contact  
Rated voltage: 250V AC  
Switching capacity: 1250VA (5A / 250V AC)  
Fusing: 5A fast acting  
Mechanical life: 20 x 10<sup>6</sup> operations  
Electrical life: 2 x 10<sup>5</sup> operations at 1000VA resistive load  
Switching frequency: max. 6/min at 1000VA resistive load (in accordance with IEC 60947-5-1)  
Overvoltage category: III (in accordance with IEC 60664-1)  
Rated surge voltage: 4kV

### 7. Measuring circuit

Measuring variable: 3(N)~, sinus, 48 to 63Hz  
Measuring input: (= supply voltage)  
Terminals: (N)-L1-L2-L3  
Overload capacity: determined by tolerance specified for supply voltage  
Input resistance: -  
Asymmetry: 5% ... 25%  
Overvoltage category: III (in accordance with IEC 60664-1)  
Rated surge voltage: 4kV

### 8. Accuracy

Base accuracy: ≤5% (of nominal value)  
Adjustment accuracy: ≤5%  
Repetition accuracy: ±2%  
Voltage influence: -  
Temperature influence: ≤0.05% / °C

### 9. Ambient conditions

Ambient temperature: -25 to +55°C  
Storage temperature: -25 to +70°C  
Transport temperature: -25 to +70°C  
Relative humidity: 15% to 85% (in accordance with IEC 60721-3-3 class 3K3)  
Pollution degree: 2 (in accordance with IEC 60664-1)

### 10. Weight

Single packing: 72g  
Packing of 10pcs: 670g per Package

Contact us

Phone: +30 26510 24011  
Fax: +30 26510 34511


Mon - Wed - Sat: 08:30-14:30  
Tues - Thur - Fri: 08:30-14:00, 17:30-21:00

Email: sales@stathisnet.gr

## Functions


### Phase sequence monitoring

When all the phases are connected in the correct sequence and the measured asymmetry is less than the fixed value, the output relay switches into on-position (yellow LED illuminated). When the phase sequence changes, the output relay switches into off-position (yellow LED not illuminated).

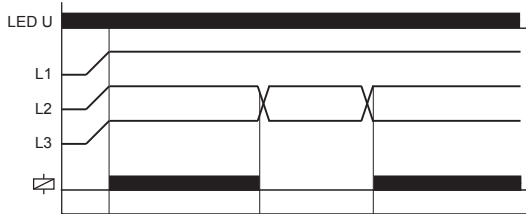


### Überwachung Phasenausfall

Das Ausgangsrelais R fällt ab (gelbe LED leuchtet nicht), wenn eine der Phasen ausfällt.

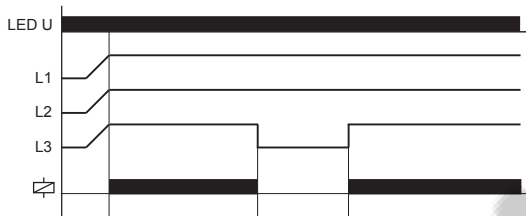


### Asymmetry monitoring


The output relay R switches into off-position (yellow LED not illuminated) when the asymmetry exceeds the value set at the ASYM-regulator. Reverse voltages of a consumer (e.g. a motor which continues to run on two phases only) do not effect the disconnection.

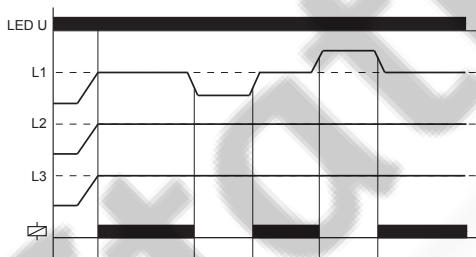

## Connections

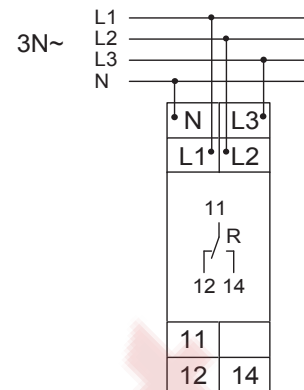

## Dimensions

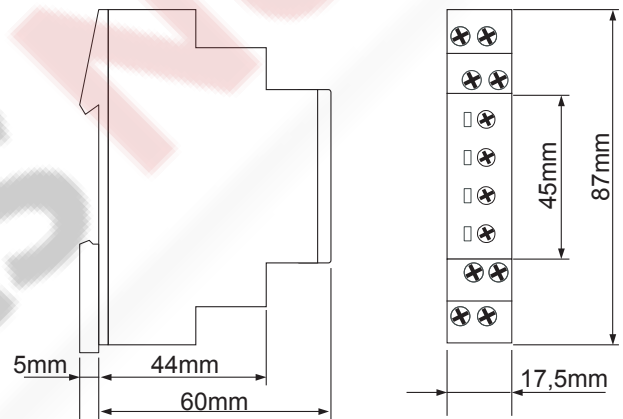

## Ordering information

Types	Rated voltage $U_N$	Switching thresholds	Part. No. (PQ 1)	Part. No. (PQ 10)
E1PF400VSY01	3(N)~ 400/230V	Asymmetrie 5%...25%	1340300	1340300A

RELEASE 2010/10

Subject to alterations and errors

Contact us